

CAGAYAN DE ORO CITY WATER DISTRICT

Corrales Avenue, Cagayan de Oro City

TECHNICAL SPECIFICATIONS

Project Title:

PR No. 15-02-07-0026 (Rebidding) – Supply and Delivery of 2,000 Pieces Brass Horizontal Control Valve 3/4" ϕ x 3/4" ϕ .


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowd_qcc@yahoo.com

3/4" x 3/4" ϕ
HORIZONTAL CONTROL VALVE

MATERIAL SPECIFICATIONS

Make	: Brass
Gross Weight	: 380 grams (minimum)
Connection Ends	MALE FEMALE
Outside Diameter	: 25.5 mm (minimum) 32 mm (minimum)
Wall Thickness	: 3 mm (minimum) 3 mm (minimum)
Length	
Horizontal	: 86 mm (minimum)
Vertical/Height	: 62 mm (minimum)
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures : Specify Delivery Packaging

DRAWINGS

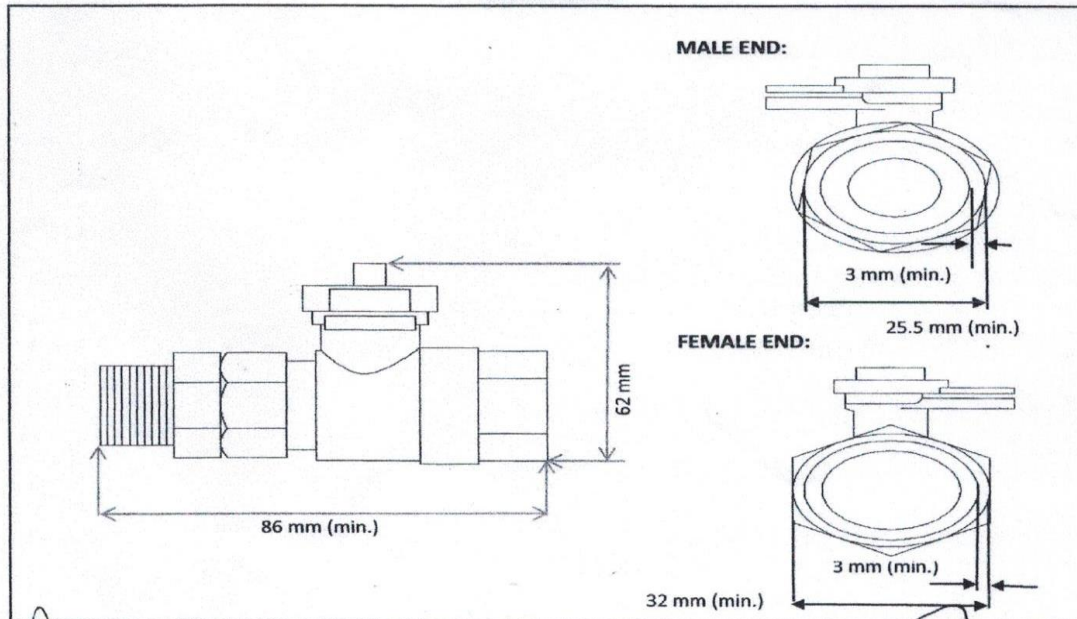

[Signature]
RUFLO B. BAGAY
Member

LARRY R. DACER
Member

[Signature]
ALLAN D. CHIONG
Member
[Signature]
MOSES W. ECHANO
Chairman

[Signature]
GLORIA H. VILLEGAS
Member / Secretary

[Signature]

Other Requirements:

Delivery : 30 calendar days upon receipt of Purchase Order.
Freight : FOB COWD Warehouse, Kauswagan, CDOC
Payment : 15 calendar days after completion and final acceptance

NOTE: Please provide your specifications on a separate page using your own letterhead.