


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowl_qcc@yahoo.com

3/4" Ø
P.E. TUBE
SDR-11

MATERIAL SPECIFICATIONS

Make	: Polyethylene
Type	: ISO
Color	: Black
Outside Diameter	: 24 mm (minimum)
Wall Thickness	: 3 mm (minimum)
Total Length per Roll	: 150 lm
Working Pressure	: 150 psi (minimum)
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures
	: Specify Delivery Packaging

DRAWINGS

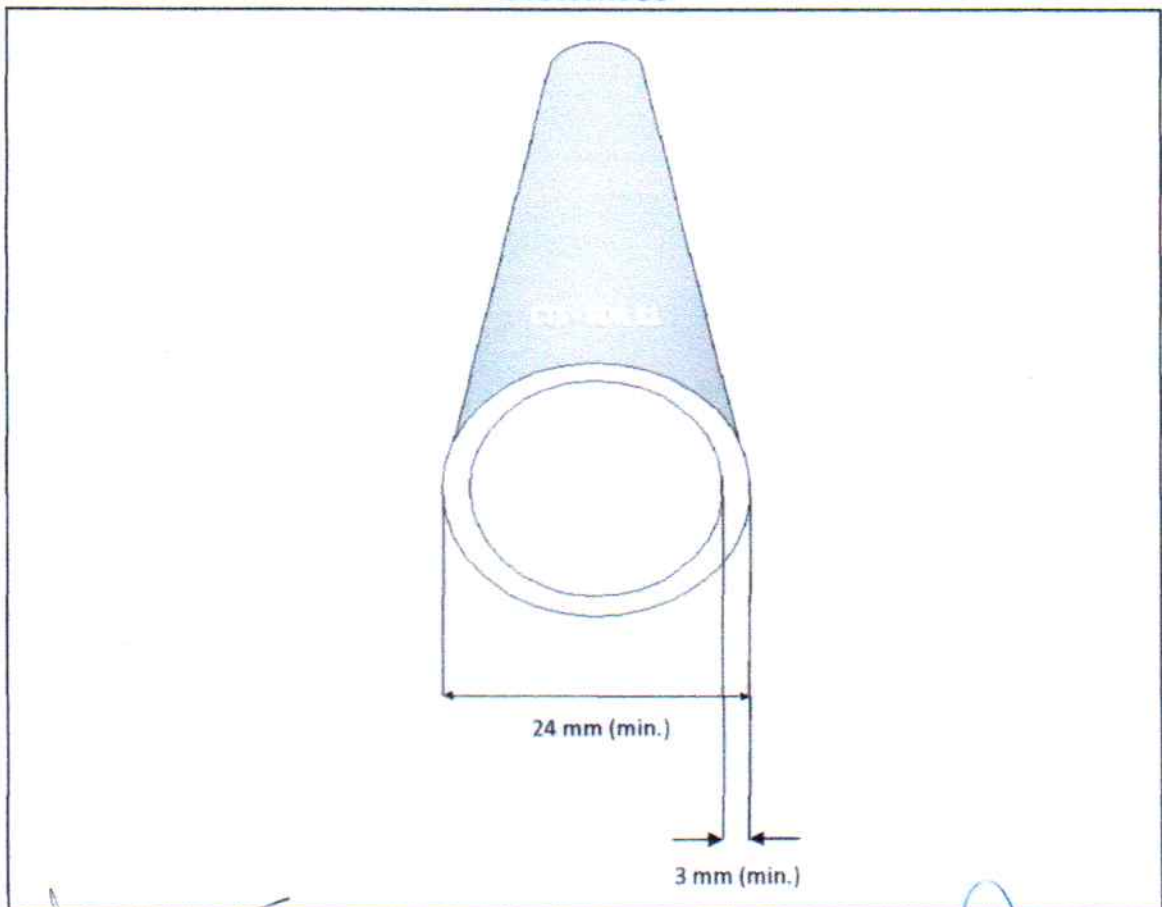

RUFO B. BAGAY
Member

LARRY R. DACER
Member

ALLAN D. CHIONG
Member

GLORIA H. VILLEGAS
Member / Secretary

JOSE JISELO P. ABRAGAN
Chairman