

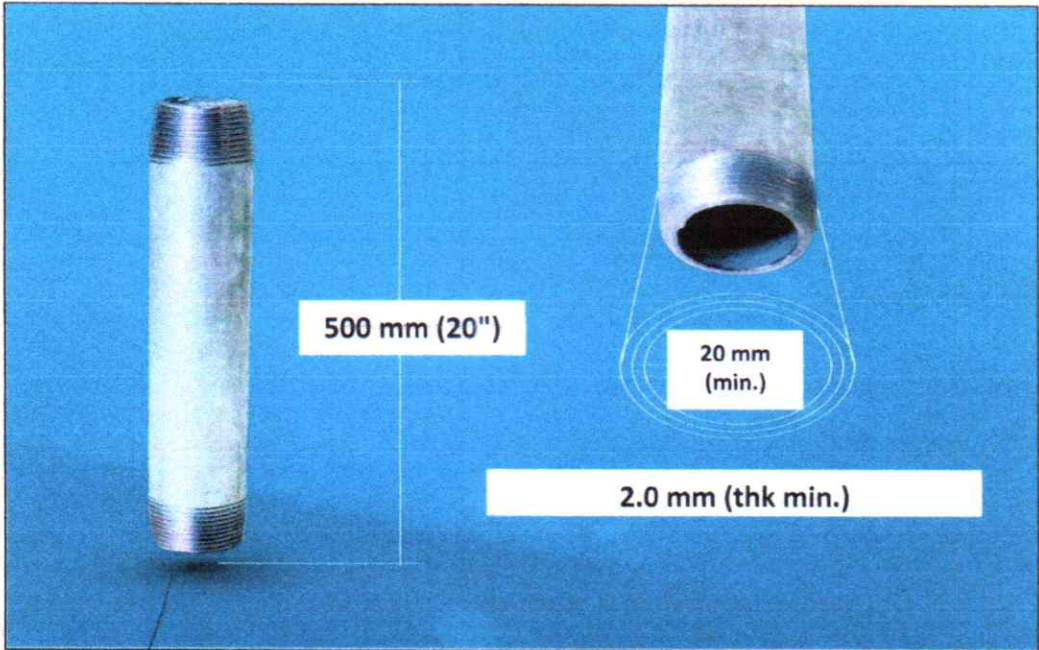
CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS


15 mmØ x 500 mm (½"Ø x 20")
GS NIPPLE
SCHD. 40

MATERIAL SPECIFICATIONS


Make	: Galvanized Steel
Description	: Male Threaded both ends
Threaded End	: MTE x MTE
Outside Diameter	: 20 mm (minimum)
Wall Thickness	: 2 mm (minimum)
Length	: 500 mm (20 inches)
Working Pressure	: 150 psi (minimum)
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures
	: Specify Delivery Packaging

DRAWINGS






EULJUN B. SALARDA
Member


ARNOLD CHRISTOPHER G. CAINGLES
Member


GRACE JOY C. YAÑEZ
Member


RODNEY E. GARCIA
Member / Secretary


REYVIC P. GALARRITA
Member / Internal Control


MARITEL D. BONDAL
Chairman

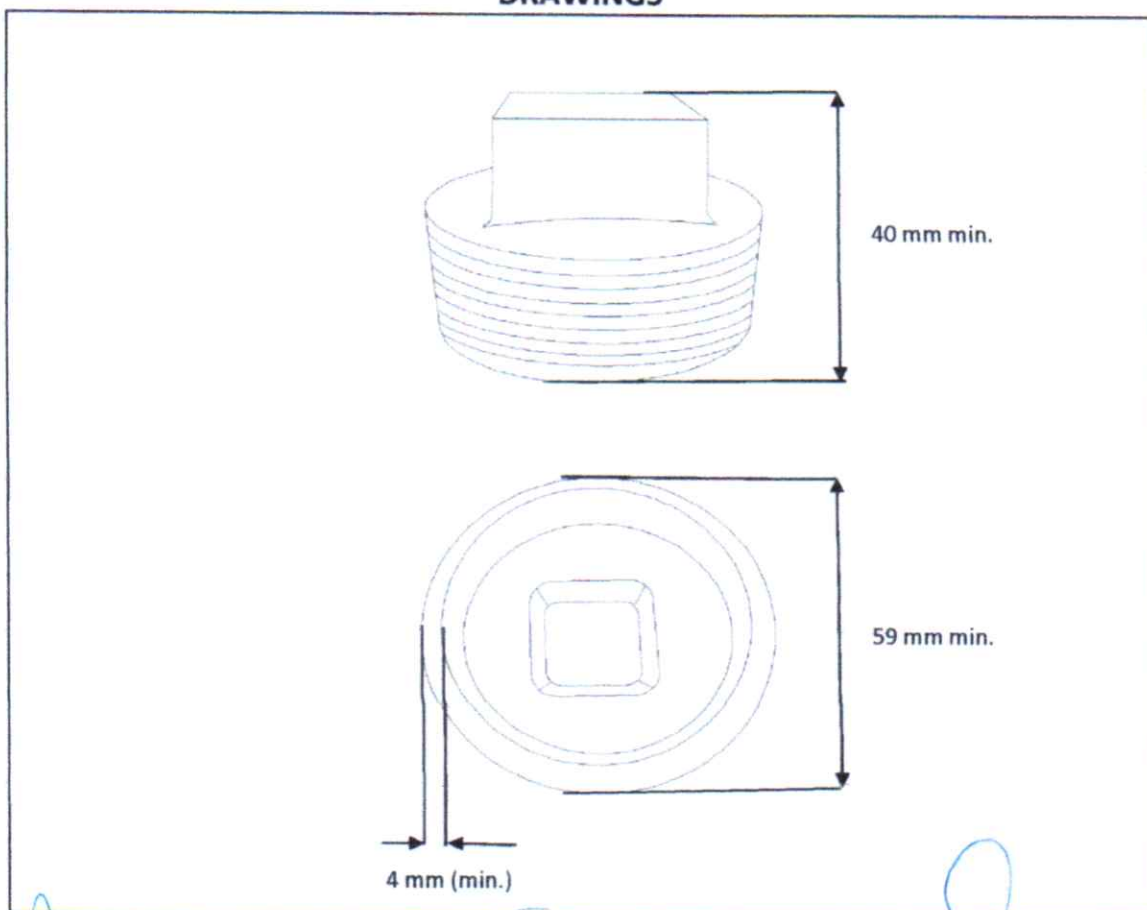
CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowsd_qcc@yahoo.com

50 mmØ
END PLUG
SCH 40

MATERIAL SPECIFICATIONS

Make	: Galvanized Iron (G.I.)
Description	: Square Head Shape
Gross Weight	: 0.25 kg (minimum)
Outside Diameter	: 59 mm (minimum)
Wall Thickness	: 4 mm (minimum)
Length	: 40 mm (minimum)
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures
	: Specify Delivery Packaging

DRAWINGS



RUFO B. BAGAY

Member

LARRY R. DACER

Member

ALLAN D. CHIONG

Member

GLORIA H. VILLEGAS

Member / Secretary

FARAH C. BAGARES

Chairman