


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowd_qcc@yahoo.com

450 mmØ (18"Ø) x 6 m long
B.S. PIPE
SCH 40

MATERIAL SPECIFICATIONS

Make	: Black Steel
Outside Diameter	: 457 mm (minimum)
Wall Thickness	: 14.27 mm (minimum)
Length	: 6 meters
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures
	: Specify Delivery Packaging

DRAWINGS

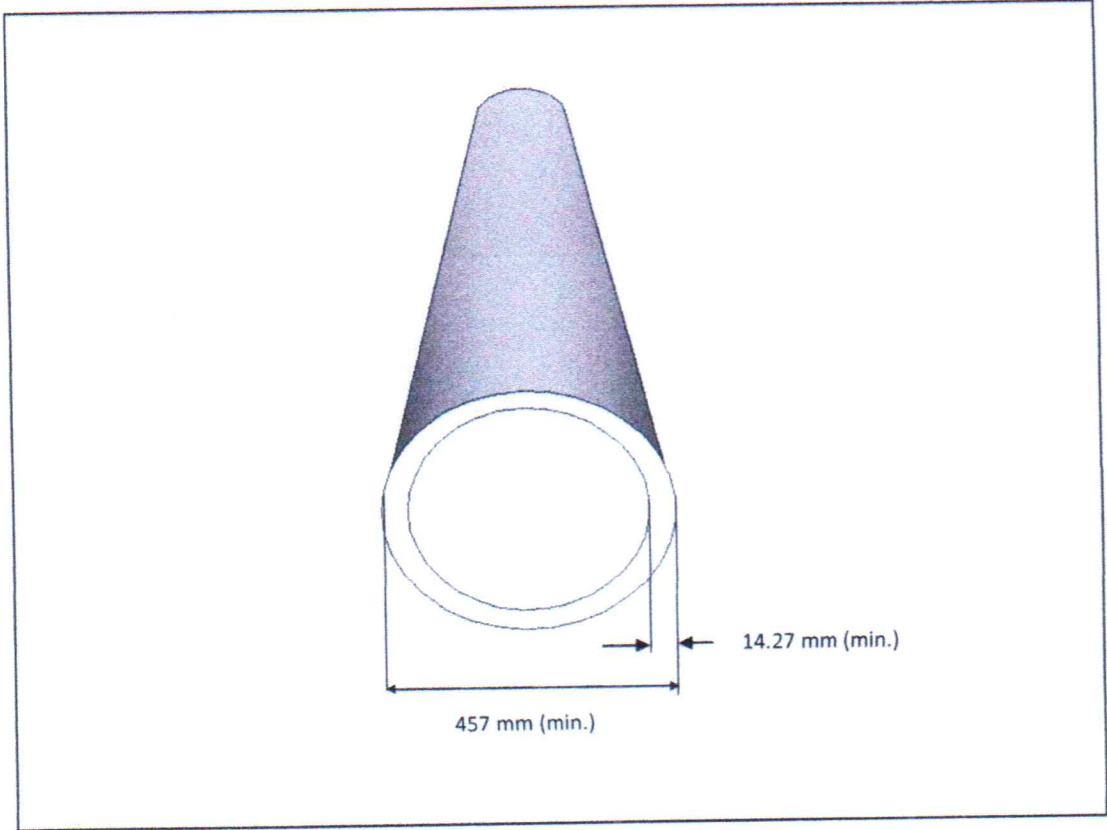


EULIO B. SALARDA
Member


ARNOLD CHRISTOPHER G. CAINGLES
Member


GRACE JOY C. YANEZ
Member


RODNEY E. GARCIA
Member / Secretary


REYVIC P. GALARRITA
Member / Internal Control


MARITEL D. BONDAL
Chairman


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowd_qcc@yahoo.com


400 mmØ (16"Ø) x 6 m long
B.S. PIPE
SCH 40

MATERIAL SPECIFICATIONS

Make	: Black Steel
Outside Diameter	: 406.4 mm (minimum)
Wall Thickness	: 12.7 mm (minimum)
Length	: 6 meters
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures : Specify Delivery Packaging


DRAWINGS

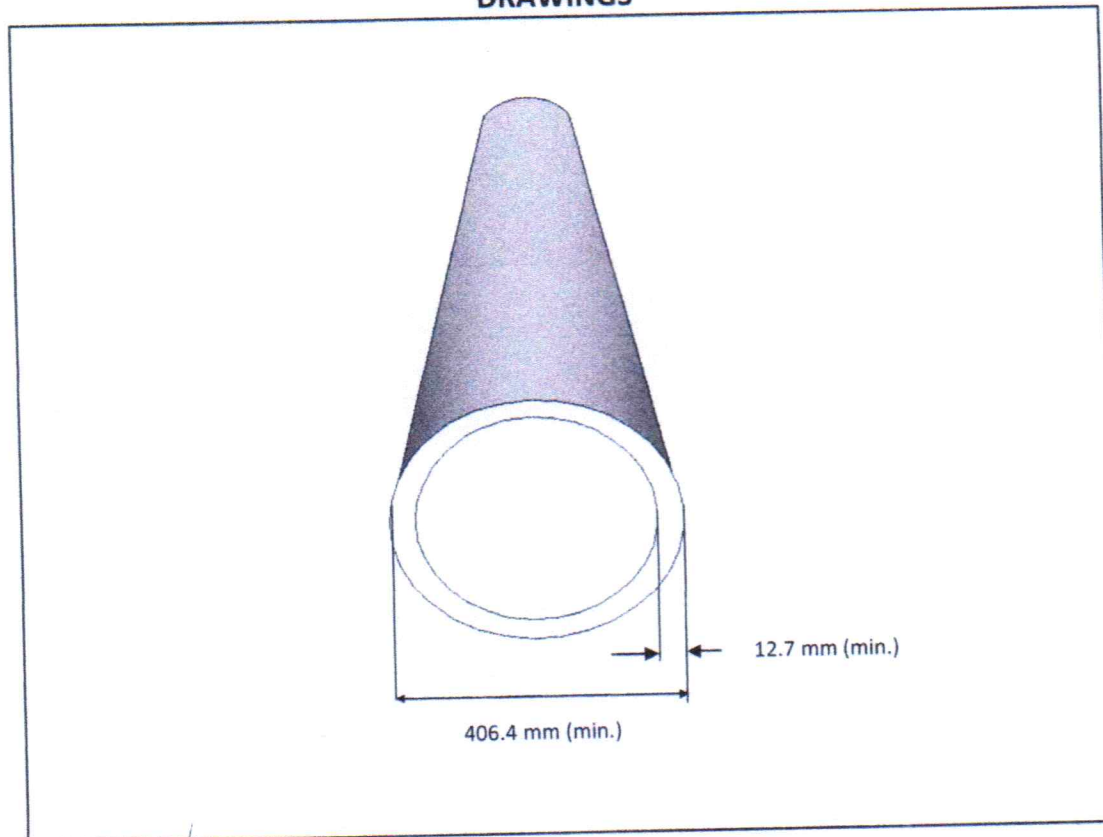



EULUN B. SALARDA
Member


ARNOLD CHRISTOPHER G. CAINGLES
Member


GRACE JOY C. YAÑEZ
Member


RODNEY E. GARCIA
Member / Secretary


REYVIC P. GALARRITA
Member / Internal Control


MARITEL D. BONDAL
Chairman


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowl_qcc@yahoo.com

300 mmØ (12"Ø) x 6 m long
B.S. PIPE
SCH 40

MATERIAL SPECIFICATIONS

Make	: Black Steel
Outside Diameter	: 323.8 mm (minimum)
Wall Thickness	: 10.3 mm (minimum)
Length	: 6 meters
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures : Specify Delivery Packaging

DRAWINGS

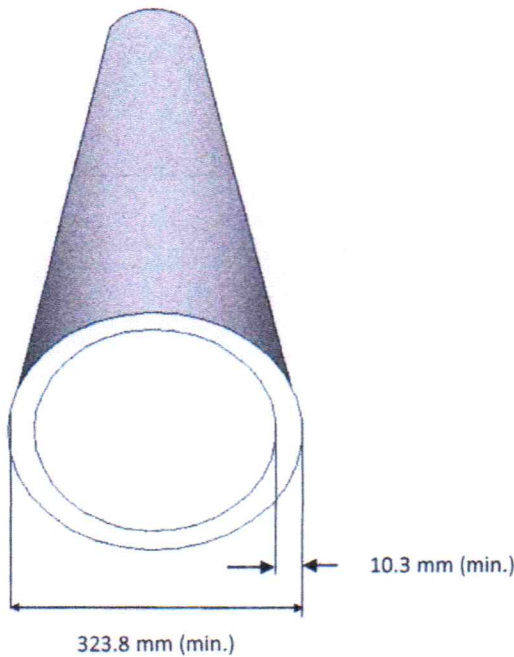


EULJON B. SALARDA
Member


RODNEY E. GARCIA
Member / Secretary


ARNOLD CHRISTOPHER G. CAINGLES
Member


REYVIC P. GALARRITA
Member / Internal Control


GRACE JOY C. YANEZ
Member


MARITEL D. BONDAL
Chairman


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowsd_qcc@yahoo.com

250 mmØ (10"Ø) x 6 m long
B.S. PIPE
SCH 40


MATERIAL SPECIFICATIONS

Make	: Black Steel
Outside Diameter	: 273 mm (minimum)
Wall Thickness	: 9.3 mm (minimum)
Length	: 6 meters
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures
	: Specify Delivery Packaging


DRAWINGS

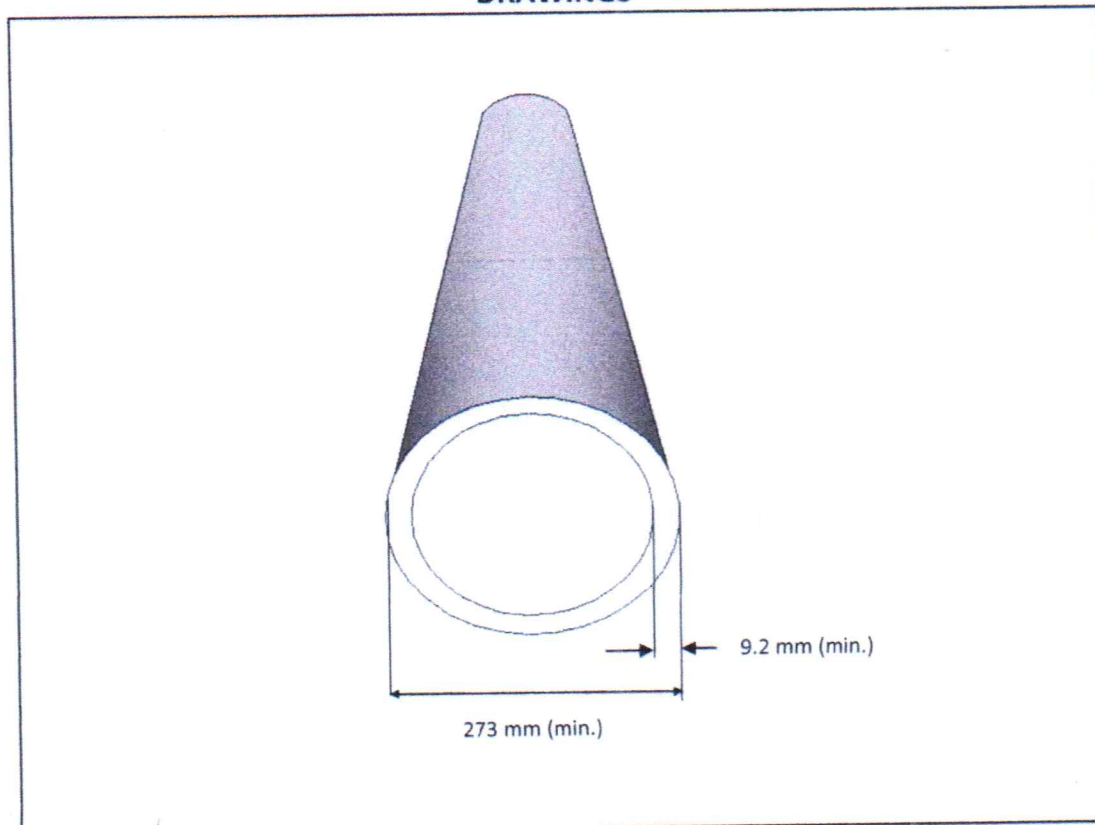



EULIJUN B. SALARDA
Member


RODNEY E. GARCIA
Member / Secretary


ARNOLD CHRISTOPHER G. CAINGLES
Member


REYVIC P. GALARRITA
Member / Internal Control


GRACE JOY C. YANEZ
Member


MARITEL D. BONDAL
Chairman


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowd_qcc@yahoo.com

200 mmØ (8"Ø) x 6 m long
B.S. PIPE
SCH 40

MATERIAL SPECIFICATIONS

Make	: Black Steel
Outside Diameter	: 219 mm (minimum)
Wall Thickness	: 8.17 mm (minimum)
Length	: 6 meters
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures
	: Specify Delivery Packaging

DRAWINGS

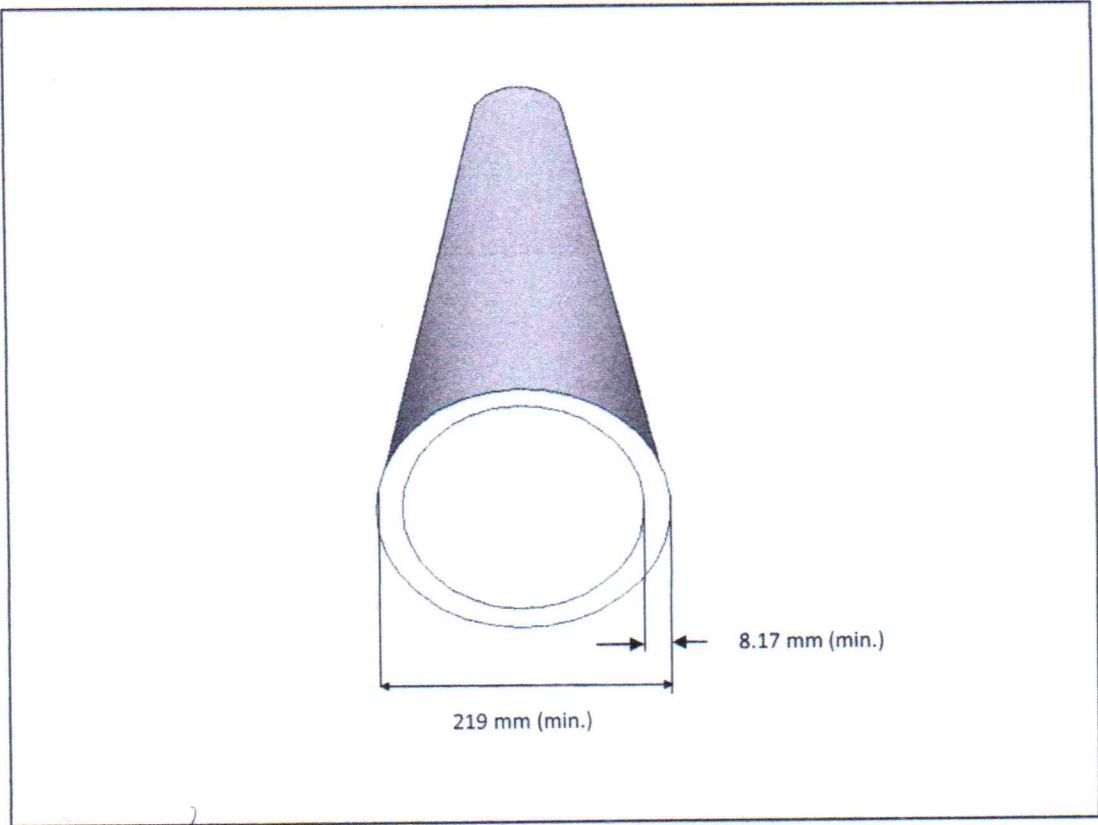


EULIJN B. SALARDA
Member


ARNOLD CHRISTOPHER S. CAINGLES
Member


GRACE JOY C. YANEZ
Member


RODNEY E. GARCIA
Member / Secretary


REYVIC P. GALARRITA
Member / Internal Control


MARITEL D. BONDAL
Chairman


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowsd_qcc@yahoo.com

150 mmØ (6"Ø) x 6 m long
B.S. PIPE
SCH 40

MATERIAL SPECIFICATIONS

Make	: Black Steel
Outside Diameter	: 168.2 mm (minimum)
Wall Thickness	: 7.11 mm (minimum)
Length	: 6 meters
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures
	: Specify Delivery Packaging

DRAWINGS

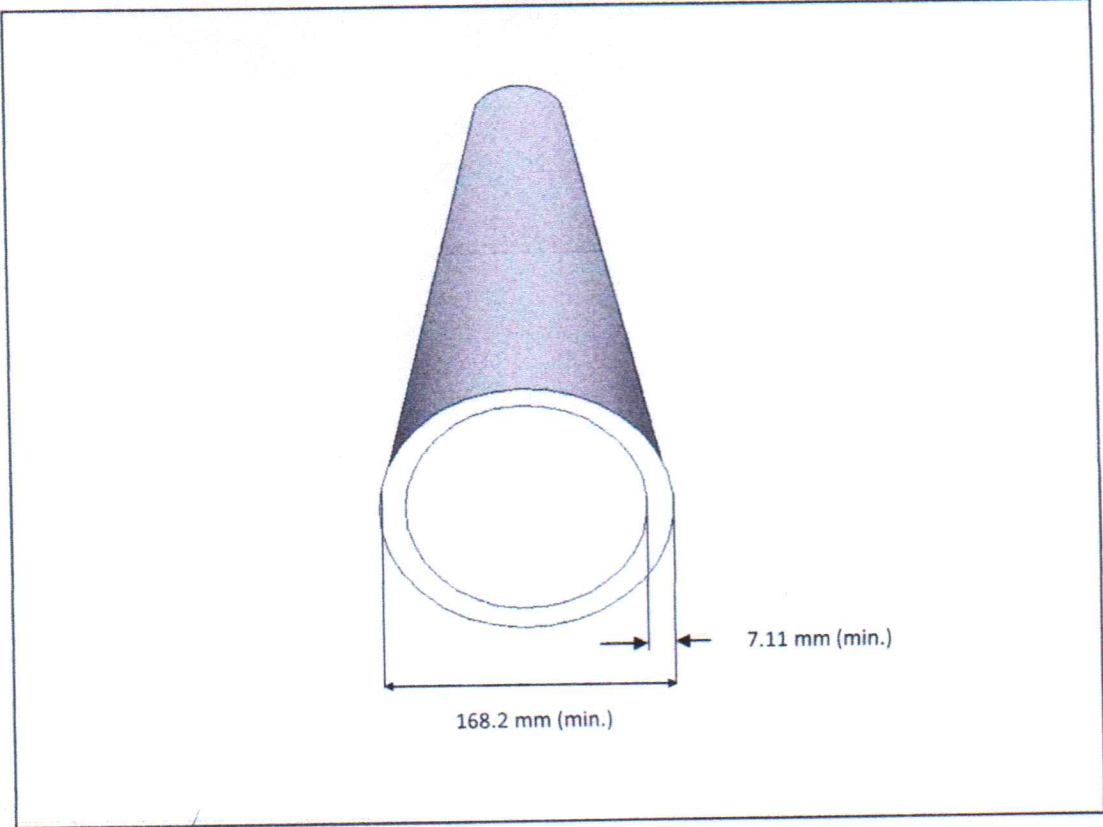


EULIAN B. SALARDA
Member


ARNOLD CHRISTOPHER G. CAINGLES
Member


GRACE JOY C. YANEZ
Member


RODNEY E. GARCIA
Member / Secretary


REYVIC P. GALARRITA
Member / Internal Control


MARITEL D. BONDAL
Chairman


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowd_qcc@yahoo.com


75 mmØ (3"Ø) x 6 m long
B.S. PIPE
SCH 40

MATERIAL SPECIFICATIONS


Make	: Black Steel
Outside Diameter	: 89 mm (minimum)
Wall Thickness	: 5.5 mm (minimum)
Length	: 6 meters
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures : Specify Delivery Packaging

DRAWINGS

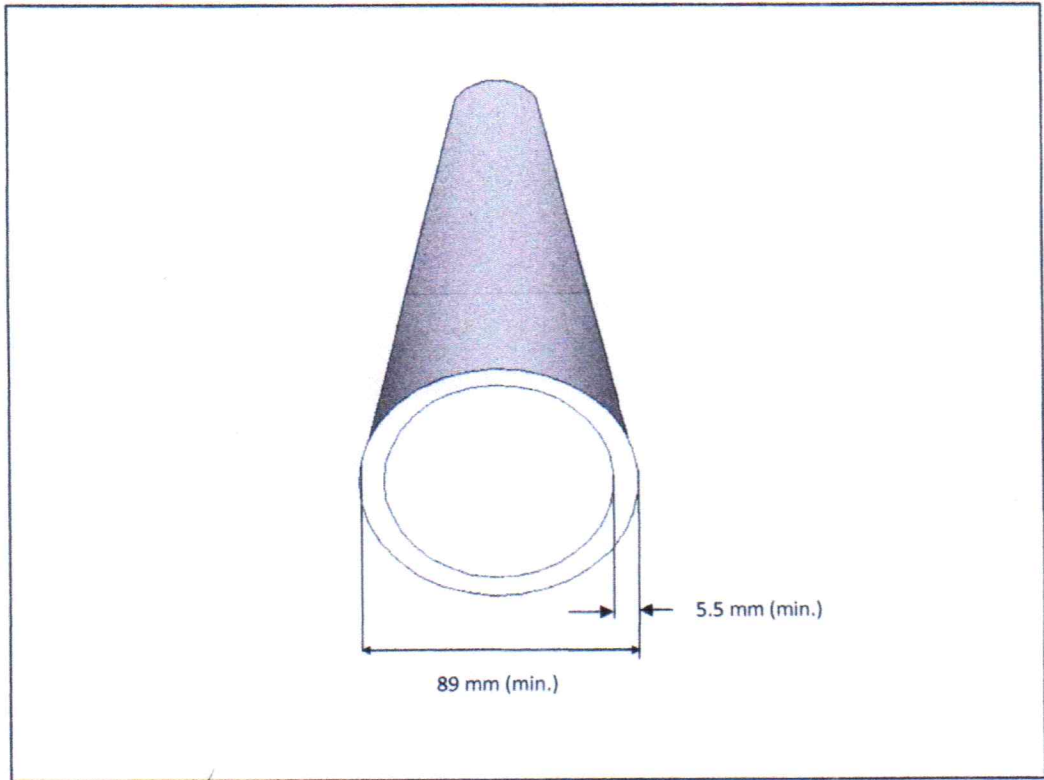



EULJUN B. SALARDA
Member


ARNOLD CHRISTOPHER G. CAINGLES
Member


GRACE JOY C. YANEZ
Member


RODNEY E. GARCIA
Member / Secretary


REYVIC P. GALARRITA
Member / Internal Control


MARITEL D. BONDAL
Chairman


CAGAYAN DE ORO CITY WATER DISTRICT
QUALITY CONTROL COMMITTEE for PIPES AND SERVICE CONNECTION MATERIALS
cowd_qcc@yahoo.com

100 mmØ (4"Ø) x 6 m long
B.S. PIPE
SCH 40

MATERIAL SPECIFICATIONS


Make	: Black Steel
Outside Diameter	: 114 mm (minimum)
Wall Thickness	: 6.02 mm (minimum)
Length	: 6 meters
Working Pressure	: 150 psi
Other Requirements	: Original Manufacturer's Product Brochures / Manual / Literatures
	: Specify Delivery Packaging


DRAWINGS

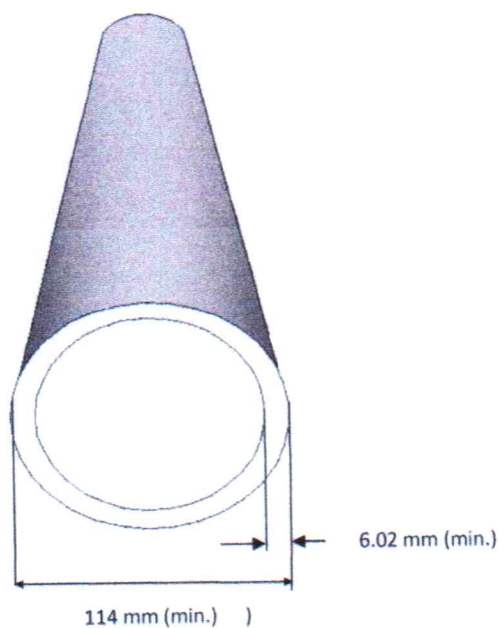



EULJUN B. SALARDA
Member


ARNOLD CHRISTOPHER G. CAINGLES
Member


GRACE JOY C. YANEZ
Member


RODNEY E. GARCIA
Member / Secretary


REYVIC P. GALARRITA
Member / Internal Control


MARITEL D. BONDAL
Chairman